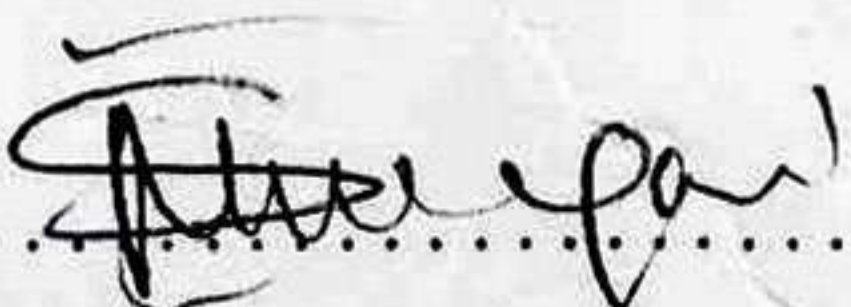



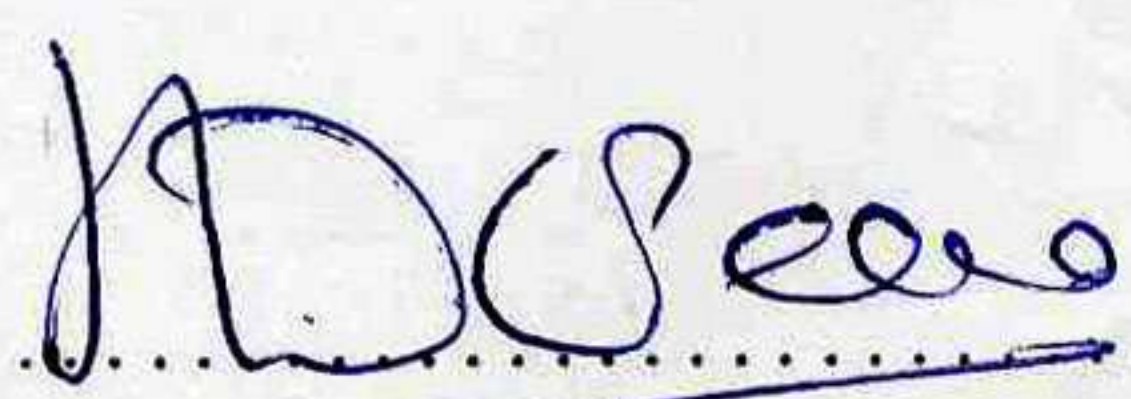
Results:

Client's Reference	Lab Code	Chloride (water soluble) (as Cl,w/w %)	Sulphate (water soluble) (as SO ₃ , g/L)
BH-2/sample 1	MS-002-1	<0.01	NT*
BH-2/sample 2	MS-002-2	<0.01	NT*
BH-2/sample 3	MS-002-3	<0.01	NT*
BH-2/sample 4	MS-002-4	<0.01	NT*
BH-2/sample 5	MS-002-5	<0.01	NT*
BH-2/sample 6	MS-002-6	<0.01	NT*
BH-2/sample 7	MS-002-7	<0.01	NT*
BH-2/sample 8	MS-002-8	<0.01	NT*
BH-2/sample 9	MS-002-9	<0.01	NT*
BH-2/sample 10	MS-002-10	<0.01	NT*
BH-2/sample 11	MS-002-11	<0.01	0.1
BH-3/sample 1	MS-002-12	<0.01	NT*
BH-3/sample 2	MS-002-13	<0.01	NT*
BH-3/sample 3	MS-002-14	<0.01	NT*
BH-3/sample 4	MS-002-15	<0.01	NT*
BH-3/sample 5	MS-002-16	<0.01	NT*
BH-3/sample 6	MS-002-17	<0.01	NT*
BH-3/sample 7	MS-002-18	<0.01	NT*
BH-3/sample 8	MS-002-19	<0.01	NT*
BH-3/sample 9	MS-002-20	<0.01	0.1

*Note: NT-Not Tested

Analysed

M. Dissanayake
Scientist

Checked

A.A.S.V. Dias
Co-ordinator W/Q

Certified

M.D.C. Perera

Head/Environmental Division
HEAD / ENVIRONMENTAL DIVISION
National Building Research Organization
No. 99/1, Jawatta Road,
COLOMBO 05,